




Carlisle Residential
Kimmage Road West
Dublin 12

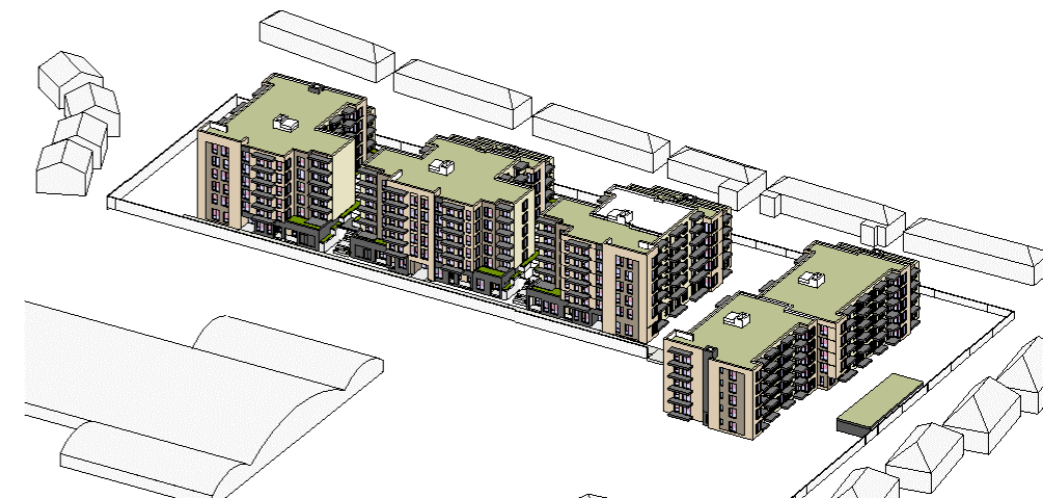

Client: 1 Terenure Land Limited

Energy Analysis Report

IN2 Project No. D2124

14.03.22

REV04

Revision History

Date	Revision	Description
24.09.21	00	Initial issue for client review
11.10.21	01	Issued for client review
13.10.21	02	Issued for planning
04.02.22	03	Issued for planning
14.03.22	04	Issued for planning

IN2 Engineering Design Partnership operates a formal Integrated Management System, with certification to IpSO: 9001 Quality Management System, ISO: 14001 Environmental Management System and OSHAS: 18001 Health and Safety Management System.

This document has been created by IN2 Engineering Design Partnership on behalf of the Client, taking account of the agreed scope of works. Unless otherwise agreed, this document and associated Intellectual Property Rights remain the property of IN2 Engineering Design Partnership.

This document should be used by the recipient and the permitted discloses for the purpose for which it has been submitted and for no other. This document may not be reproduced, stored in a retrieval system or transmitted in any form or by any means, electronic, mechanical, photocopying, recording or otherwise disclosed in whole or in part to any third party without our express prior written consent from IN2 Engineering Design Partnership. This document is confidential in nature. All rights reserved.

When issued or transmitted electronically via email, cloud, file hosting service or similar, IN2 Design Partnership does not accept any responsibility for any unauthorised changes made to this document by others.

In preparing this document, IN2 Design Partnership has exercised all reasonable skill and competence, accounting for the agreed contract objectives and scope of works. IN2 Design Partnership does not accept any liability in negligence for any matters arising outside of the agreed contract objectives and scope of works.

Registered Office: Unit E, Mount Pleasant Business Park, Upper Mount Pleasant Avenue, Dublin 6

Company Registration No.: 466565

Table of Contents

Revision History	2	4.5 Block 1, Level 5 - 2 Bed Apartment Type B2 Mechanical & Electrical Installations	22
Table of Contents	3	4.5.1 Primary Heat Generator	22
1.0 Executive Summary	4	4.5.2 Heating Installations	22
2.0 Building Regulations	5	4.5.3 Hot Water Installations	23
2.1 NZEB	5	4.5.4 Ventilation Installations	23
2.2 Part L 2019	6	4.5.5 Lighting Installations:	23
2.3 Primary Energy	8	4.5.6 Renewable Technologies	23
2.4 Renewable Technologies	9	4.5.7 Part L Compliance	24
2.5 Route to Net Zero Carbon	10	5.0 Development Average	25
3.0 Proposed Heating Strategy Plant	11		
3.1 Decentralised Exhaust Air Heat Pump	11		
4.0 Energy Analysis	12		
4.1 Building Construction	12		
4.2 Block 1, Level 3 - 1 Bed Apartment Type A1 Mechanical & Electrical Installations	13		
4.2.1 Primary Heat Generator	13		
4.2.2 Heating Installations	13		
4.2.3 Hot Water Installations	14		
4.2.4 Ventilation Installations	14		
4.2.5 Lighting Installations:	14		
4.2.6 Renewable Technologies	14		
4.2.7 Part L Compliance	15		
4.3 Block 2, Level 5 - 1 Bed Apartment Type A2 Mechanical & Electrical Installations	16		
4.3.1 Primary Heat Generator	16		
4.3.2 Heating Installations	16		
4.3.3 Hot Water Installations	17		
4.3.4 Ventilation Installations	17		
4.3.5 Lighting Installations:	17		
4.3.6 Renewable Technologies	17		
4.3.7 Part L Compliance	18		
4.4 Block 1, Level 5 - 2 Bed Apartment Type B1 Mechanical & Electrical Installations	19		
4.4.1 Primary Heat Generator	19		
4.4.2 Heating Installations	19		
4.4.3 Hot Water Installations	20		
4.4.4 Ventilation Installations	20		
4.4.5 Lighting Installations:	20		
4.4.6 Renewable Technologies	20		
4.4.7 Part L Compliance	21		

1.0 Executive Summary

The proposed development is located at Kimmage Road Lower Dublin 12. The development comprises approximately 208 no. residential units.

This report outlines the current building regulations framework and the requirement to achieve Nearly Zero Energy Building (NZEB) standard for all new developments. The report describes how the NZEB standard is demonstrated using the SEAI approved Dwelling Energy Assessment Procedure (DEAP) software.

Section 2 provides a brief overview of Building Regulations, Renewable Technologies as well as defining Primary Energy.

Section 3 includes a descriptive summary of the proposed heating system strategy for the Carlisle residential development. As demonstrated in section 4, the proposed heating strategy is to utilise exhaust air heat pumps for Carlisle to achieve NZEB compliance and would be a suitable option for this development.

Section 4 outlines the mechanical and electrical installations information used for the energy analysis undertaken for the Carlisle residential development to determine Part L compliance. This includes recommendations for the minimum fabric and design parameters necessary to achieve compliance.

Section 5 describes the result of averaging the DEAP results of all the apartments to get a development average result for compliance with Part L.

2.0 Building Regulations

2.1 NZEB

Building energy has long been understood as contributing a major component of greenhouse gas emissions. This was acknowledged within the 2030 Communication published by the European Commission (2014), which stated that *“the majority of the energy-saving potential (for the EU) is in the building sector”*

The 2010 EU Energy Performance of Buildings Directive (EPBD) sets out the target that all new developments should be Nearly Zero-Energy Buildings (NZEB) by the end of 2020. A Nearly-Zero Energy Building is defined in the Directive as having *“very high energy performance”, with Article 2 of the EPBD outlining that “the nearly zero or very low amount of energy required should be covered to a very significant extent by energy from renewable sources, including energy from renewable sources produced on-site or nearby”*.

Interpretation and implantation of these statements within the directive are at the discretion of each EU Member State in accordance with their *“National, Regional or Local considerations”* and thus the definition of NZEB itself varies greatly between different countries.

For new dwellings in Ireland, NZEB has been defined as being (primarily) associated with demonstrating the following characteristics are achieved:

- Primary Energy/ Carbon Emissions: 70% reduction against Part L 2005
- Renewable Energy: 20% of this Primary Energy required

These NZEB targets have been now incorporated within the current Technical Guidance Document (TGD) Part L 2019, as discussed in section 2.2.

Figure 2.1.1 illustrates comparative Primary Energy consumption for Dwellings in Ireland from the 1970’s through to current NZEB standards. It may be seen that continued improvements in Primary Energy consumption over the past 20years have been maintained by the ongoing revisions to the building regulations.

Figure 2.1.2 illustrates the NZEB targets for Primary Energy (and Carbon Emissions) and Renewable Energy. The Part L 2005 benchmark could be expected to achieve a B3 BER, in comparison to A2 for NZEB compliance.

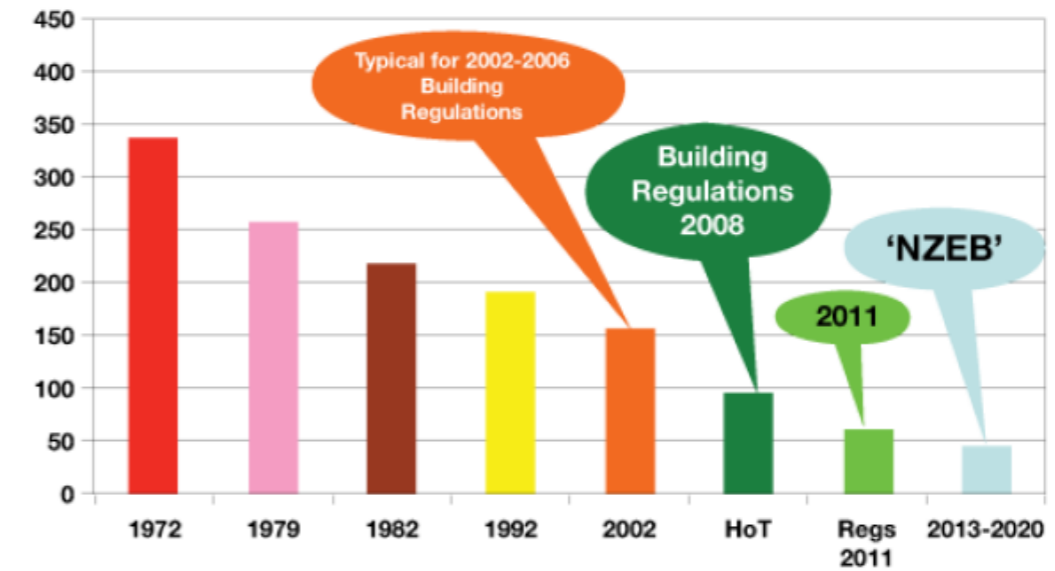


Figure 2.1.1: Primary Energy Consumption in Irish Housing 1972-2020

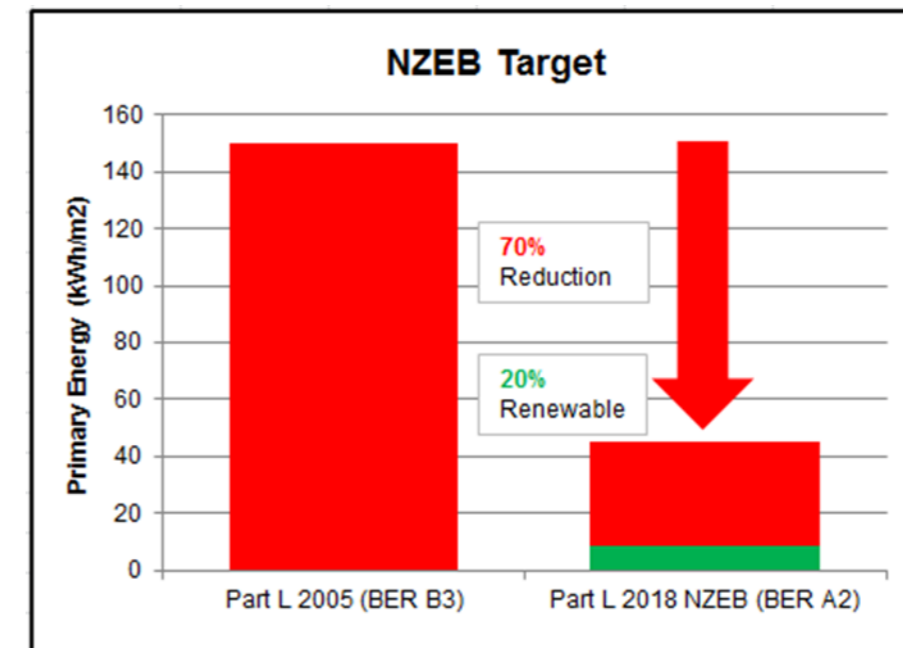


Figure 2.1.2: NZEB Targets

2.2 Part L 2019

Technical Guidance Document (TGD) Part L Conservation of Fuel and Energy – Dwellings outlines how compliance to this element of the Building Regulations may be demonstrated through the utilisation of the Dwelling Energy Assessment Procedure (DEAP) software, which analyses comparative energy usage for a particular residence.

The energy assessment is determined annually on a floor area basis (kWh/m².ann) under the following headings, known as “regulated loads”:

- Heating
- Hot Water
- Auxiliary (Fans, Pumps and Controls)
- Lighting

It should be noted that significant energy loads within dwellings; particularly equipment associated with cooking, washing etc. are excluded from DEAP analysis and associated Part L Compliance/ BER calculations. These energy loads, known as “unregulated loads” are deemed to be associated with operational usage which is not consistent across all dwellings, as opposed to the building’s fabric and services performance.

Figure 2.2.1 indicates an energy breakdown for a typical apartment (100m², local gas-fired boiler) compliant to NZEB / Part L 2019. It can be seen that Hot Water Energy consumption pre-dominates accounting for over half of the primary energy consumed, with Heating Energy considerably lower. This is reflective of the extensive improvements to insulation / air permeability / thermal bridging / glazing / heating system efficiency etc. through successive Building Regulation revisions over recent years.

As both Hot Water and Lighting Energy consumption are effectively fixed within the calculation methodology (as based on standardised databases of hot water usage etc.), further improvements to Heating related items (insulation etc.) are generally required to ensure overall compliance can be achieved.

The following minimum Fabric Performance targets are defined in Part L 2019:

Thermal Transmittance (U-Values)

- Roofs: 0.16 W/ m²K
- External Walls: 0.18 W/ m²K
- Ground/ Exposed Floors: 0.18 W/ m²K
- Windows/ Doors/ Rooflights: 1.40 W/ m²K

Air Permeability

- Maximum Air Leakage: 3 m³/hr.m² @ 50Pa

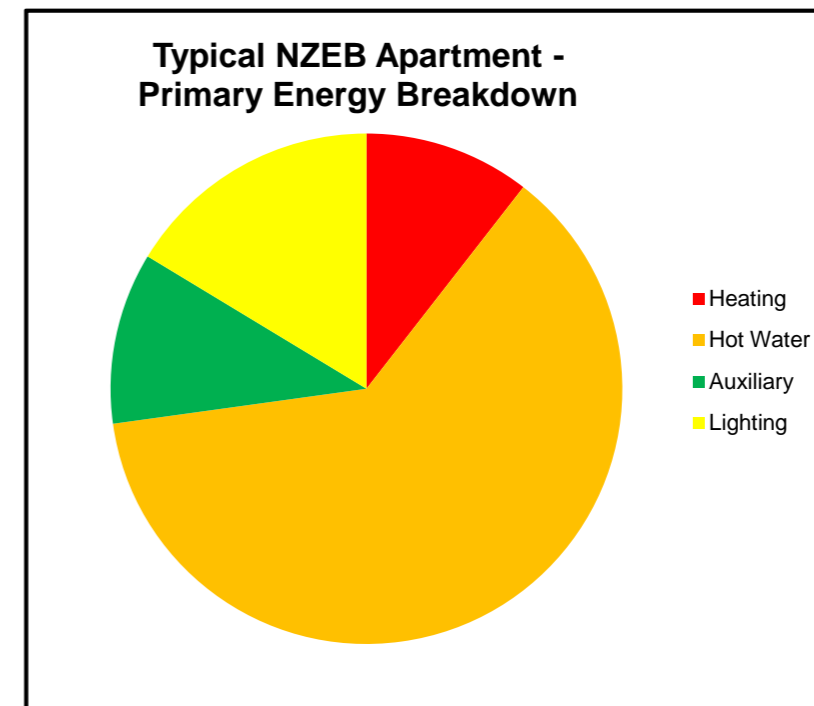


Figure 2.2.1: Typical Residential Primary Energy Breakdown

The Part L regulations specify that for apartments or other terraced residential buildings compliance can be demonstrated based on the average of all dwellings for each of the parameters associated with Part L, namely Primary Energy (EPC), Carbon Emissions (CPC) and Renewable Energy (RER). Therefore, for the purposes of analysis, an apartment representative of the average attributes of the dwellings has been selected.

In summary, DEAP analysis must demonstrate the following to ensure compliance to Part L 2019:

- Energy Performance Coefficient (EPC): 0.30 or lower
(ie. 70% reduction in Primary Energy against Part L 2005 benchmark)
- Carbon Performance Coefficient (CPC): 0.35 or lower
- Renewable Energy Ratio (RER): 0.20

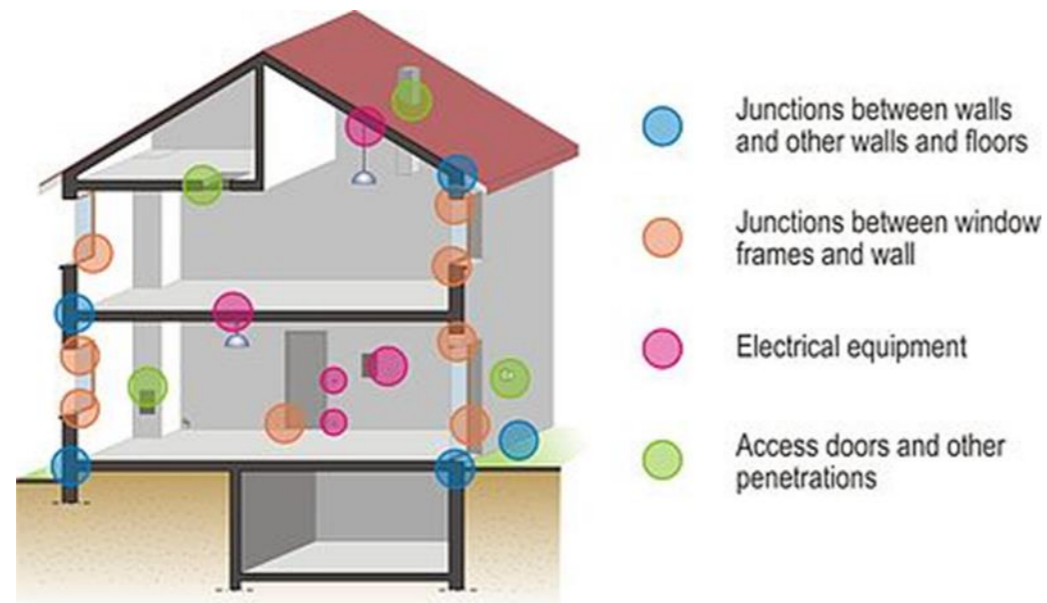


Figure 2.2.2: Common areas of air leakage

2.3 Primary Energy

In assessing energy performance for dwellings, Part L (and BER) utilises Primary Energy as a means of comparative analysis. This relates to the energy at source as required for the dwelling, as opposed to that consumed within the actual building. For example, electrical Primary Energy relates to that required for both generation (based on average of power plant fuels and efficiencies) and transmission for electricity through the ESB grid.

Primary Energy Factor (PEF) conversions for main fuel types are as follows:

- Electricity: 2.08
- Natural Gas: 1.10

It can be seen from the above that the Primary Energy conversion for Electricity is twice that of Natural Gas (as well as other fossil fuels and biomass); therefore a direct electric heater would consume double the Primary Energy of an LPHW radiator. However, as can be seen from Figure 2.3.1, the underlying trend over time has been that the Primary Energy of electricity with respect to Natural Gas (and other fuels) has been reducing (due to the increased “greening” of the ESB grid with Wind and Solar renewables and more efficient plant operation), with the following impacts in terms of technologies and associated Part L compliance, as PEF for electricity reduces.

- Heat Pump, both Air Source and Geothermal, are becoming increasingly viable.
- Natural Gas Combined Heat and Power (CHP) is becoming less viable.
- Larger Photovoltaic (PV) arrays required to offset electricity usage (albeit offset by increases in PV efficiency for equivalent array sizes).

As the efficiency of the Electrical grid continues to improve the current Part L 2019 PEF is based on the average of the projected Electrical grid efficiency over the next 10 years.

The associated Carbon Factors for main fuel types in Ireland are as follows:

- Electricity: 409 gCO₂/kWh
- Natural Gas: 203 gCO₂/kWh

The Carbon Factors associated with electricity have fallen by approximately 26% in Ireland over recent years (from 635 gCO₂/kWh in 2005) as renewable technologies are

added to the grid however the reliance on natural gas, peat and coal ensures electricity remains a relatively significant source of carbon emissions.

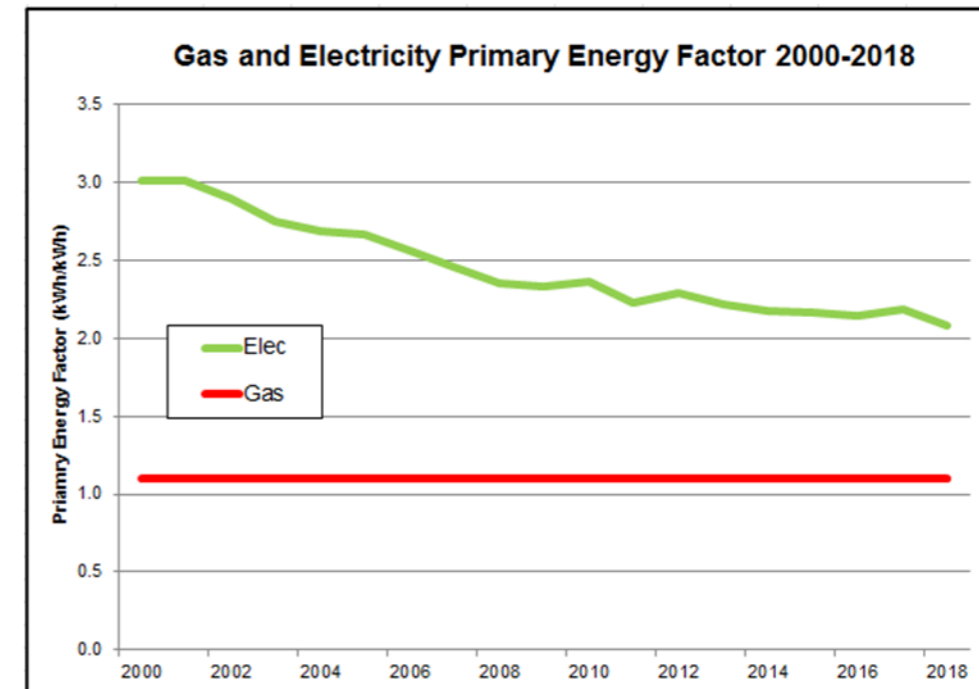


Figure 2.3.1: Primary Energy Factors for Gas and Electricity 2000-2018

2.4 Renewable Technologies

In addition to improving heating energy efficiency, renewable technologies can be utilised to significantly reduce Primary Energy requirements (while ensuring the RER renewable energy percentage is also achieved). Figure 2.4.1 indicates how, for a typical apartment (notional 100m², gas boiler plant) designed to ensure NZEB compliance, 4no. PV panels (250W each) would offset the excess energy within the gross consumption. This extent of renewable energy must be at least 20% of the overall Primary Energy (RER =0.20+).

With regards to renewable energy technology solutions, the most suitable options for apartment design, ensuring compliance with Part L in a cost-effective manner, are as follows:

- Air Source Heat Pumps (ASHP)

Reduces Primary Energy associated with both Heating and Hot Water compared to gas boilers. Can be implemented on either a centralised or decentralised basis (see Section 2.5). Typically Heat Pump efficiencies (seasonal CoP) of 450% are available.

A centralised solution would include a large commercial heat pump sized to provide the base heating load and supplemented with gas boilers. A decentralised solution would include Air Source Heat Pump technology located in each apartment.

- Photovoltaics (PV)

Offsets Primary Energy associated with Electricity. Most cost-effective where installed as part of Centralised plant arrangement, with single array interlinked to Landlord electricity supply (as opposed to individual units).

The centralised and decentralised portions of this section explain the current method in dealing with the renewable contribution to each apartment and landlord area for both a centralised system and a decentralised system.

Centralised Air source Heat Pump & Boilers:

In this configuration, the heat from the Air Source Heat Pump (ASHP) contributes renewable energy to both the Apartment and the landlord areas. If this contribution is insufficient a small Landlord PV array may be included to increase the renewable energy contribution.

Current Part L 2019 regulations require a Renewable Energy Ratio (RER) of 20% for each apartment. The landlord areas (separately assessed as a commercial building) must also be served by a renewable technology to be deemed compliant.

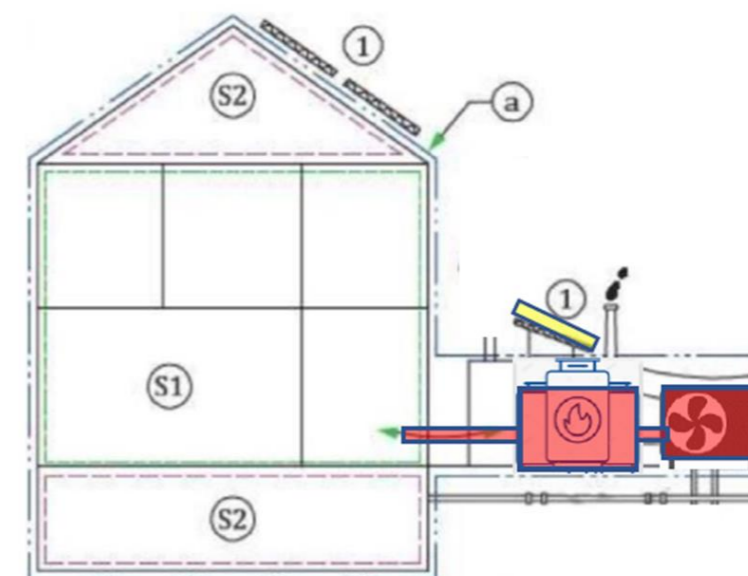


Figure 2.4.1: Centralised Boilers/ASHP with PV array (if required) to Landlord Areas

Decentralised Exhaust Air Heat Pump:

In cases where an Exhaust Air Heat Pump (EAHP) is provided but is insufficient to meet the total renewable contribution for the Apartment it serves; compliance may be achieved by supplementing this system with PV.

In contrast to the centralised option, the decentralised option will not provide the landlord areas with any renewable contribution as the system is designed only to serve the apartment it sits in. The landlord areas will therefore require separate renewable technology. This is typically achieved with a PV panel array.

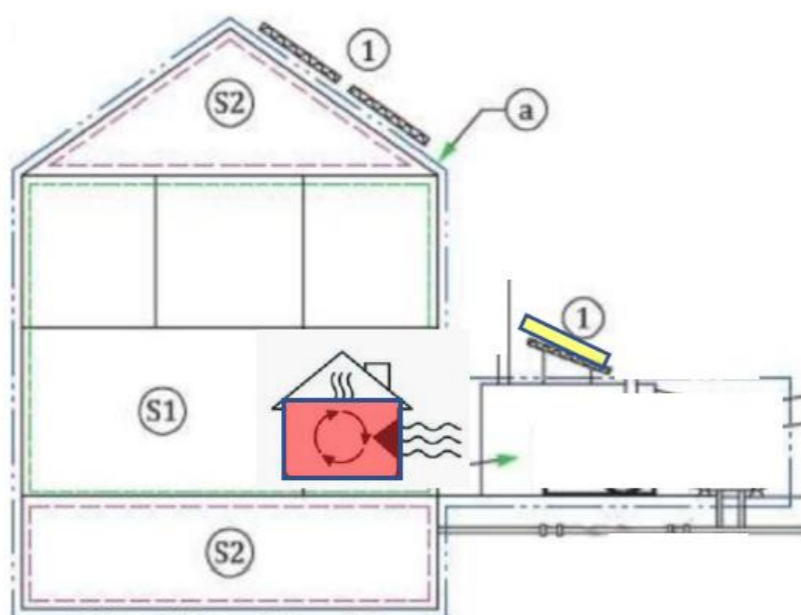


Figure 2.4.2: Centralised Boilers/ASHP with PV array (if required) to Landlord Areas

2.5 Route to Net Zero Carbon

As outlined in section 2.3 the building regulations in Ireland assess both primary energy consumption and carbon intensity. The carbon intensity that is applied for electricity within the DEAP methodology is the grid average. There is therefore no benefit to the NZEB calculation for changing to a renewable electricity supplier. This approach was taken by the SEAI in developing the regulations to ensure that buildings would be designed to prioritise reducing primary energy consumption regardless of the energy source.

Although sourcing renewable energy providers will not affect the results of the NZEB calculations this approach should still be considered as best practice.

Renewable Gas

An EU commissioned report has found Ireland has the highest potential for Renewable Gas production per capita in Europe. This is based on Anaerobic Digestion technology which generates biogas from grass or manure.

Renewable gas is currently projected to make up 12% of the gas grid by 2030 however renewable gas is not currently widely available to customers.

Renewable Electricity

Ireland in 2019 delivered 36% of electricity from renewable sources. This is due to continue to rise in the coming years with Eirgrid reporting a target of 60%-70% renewable electricity by 2030 dependant on consumption patterns.

Renewable electricity is widely commercially available and should be considered when choosing an energy supplier for the development.

3.0 Proposed Heating Strategy Plant

3.1 Decentralised Exhaust Air Heat Pump

This is a decentralised solution in which each apartment is provided with an exhaust air heat pump with an integrated hot water cylinder and an optional mechanical heat recovery module (included in costs). The system includes 2 no. ventilation extract fans, hot water cylinder and LPHW heat exchanger and circulation pumps.

This solution relies on the trickle vents to the windows or passive ducted vents to provide the background ventilation to the living rooms and bedrooms. The warm exhaust air from the apartment is extracted via the heat pump from the bathrooms and kitchen area. This improves the efficiency of the heat pump which then heats both domestic hot water and provides LPHW to serve the radiators.

As the heat pump relies on warm air from the apartment to maintain capacity the system operates 24hours a day maintaining the apartment at a minimum of 18°C. While this ensures comfort conditions are constant it is inherently less efficient as the apartment must be heated when not in use. The heat pump is electric therefore the only bills to the tenant would be for electricity.

Cold water storage would be located centrally at basement level and pressure boosted to all apartments to eliminate noisy pumps and failure points within residential areas.

Sustainability

The CO₂ emissions associated with the heating, hot water, ventilation, and lighting for a typical Carlisle apartment averages **626kg/year**.

This is an all-electric solution therefore a renewable energy electrical contract will permit the development to be marketed as fossil fuel-free.



Figure 4.1.1: Exhaust Air Heat Pump

Key Figures (per Apartment):

- Annual CO₂ emissions: 547kg

4.0 Energy Analysis

To determine Part L compliance, a detailed energy analysis was completed for the different Carlisle development apartment types. The analysis was completed using the building control approved Dwelling Energy Assessment Procedure (DEAP) software administered by Sustainable Energy Authority Ireland (SEAI) on behalf of the Department of Housing, Planning and Local Government.

4.1 Building Construction

Sample apartments within the development were taken based on worst-case scenarios, i.e.; dual aspect, north-facing glazing, sheltered on only one side etc. These apartments were selected for the purposes of analysis with a small element of exposed floor and roof allowed for to simulate the whole block average. The following building performance was assumed for analysis, in terms of Thermal Transmittance, Glazing Parameters, Air Permeability and Thermal Bridging, respectively:

Building Construction and U-Values		
Element Type	Part-L 2019 Regulations	Targeted
Roof	0.16 W/m ² k	0.15 W/m ² k
External Wall	0.18 W/m ² k	0.18 W/m ² k
Ground/Exposed Floors	0.18 W/m ² k	0.18 W/m ² k – where applicable
Windows/Doors/Rooflights	1.4 W/m ² k	1.2 W/m ² k
Heat Transmission Coefficient	0.08 W/m ² k (ACD's)	0.08 W/m ² k

Table 4.1.1: Building Construction & U-Values

Glazing Parameters	
Total Solar Heat Transmittance	0.63
Framing Factor	0.70
Overshadowing	Very little

Table 4.1.2: Glazing Parameters

Miscellaneous Building Parameters	
Element	Value Targeted
Air Leakage Rate	
Shower Flow Rates	6 l/min
Water Usage	125 l/person/day
Lighting	100% LED
Air Permeability (Air Leakage)	0.15 ac/hr @50 Pa
Thermal Bridging (Heat Transmission Coefficient)	0.08 W/m ² K

Table 4.1.3: Miscellaneous Building Parameters

4.2 Block 1, Level 3 – 1 Bed Apartment Type A1 Mechanical & Electrical Installations

The following sub-sections detail the mechanical and electrical installation information used during the DEAP assessment for the typical 1 Bed Apartment Type A1. This information comprises of the following:

- Primary heat generator
- Heating installations
- Hot water installations
- Ventilation installations
- Lighting installations

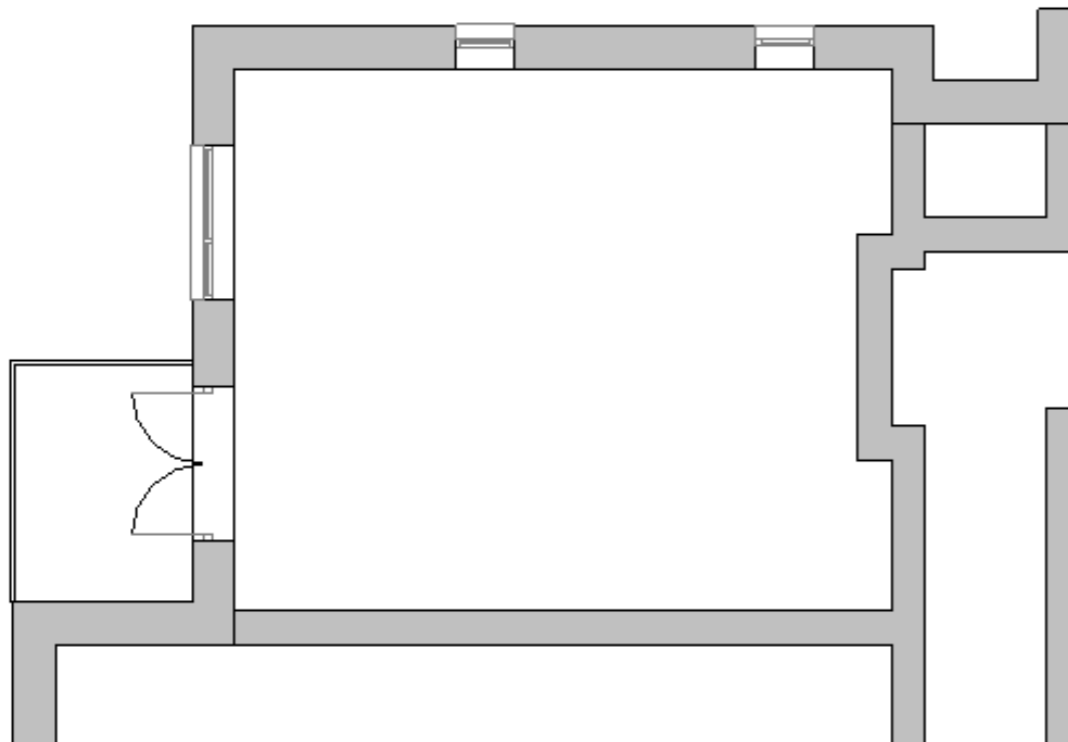


Figure 4.2.1: Typical 1 Bed Type A1 Apartment

4.2.1 Primary Heat Generator

Primary Heat Generator	
Type	Exhaust Air Source Heat Pumps (De-Centralised)
Model:	ComfortZone EX35
Fuel:	Electricity
Heating (HTG) Flow Temperature:	45°C
Hot Water (HWS) Flow Temperature:	55°C
HTG Seasonal Energy Efficiency Ratio:	555.97%
HWS Seasonal Energy Efficiency Ratio:	251.86%

Table 4.2.1: Primary Heat Generator

4.2.2 Heating Installations

Heating Installations	
Type	Decentralised
Distribution:	Exhaust Air Heat Pumps
Heat Emitter:	Radiators

Table 4.2.2: Heating Installation

4.2.3 Hot Water Installations

Hot Water Installations	
Type	Exhaust Air Source Heat Pumps (De-Centralised)
Storage Type:	Exhaust Air Heat Pump Cylinder
Storage Volume:	170 Litres
Fitting Flow Rates	
- Shower	6 l/min
- Bath	N/A
- Sink	N/A
- Wash hand basin	N/A

Table 4.2.3: Hot Water Installations

4.2.4 Ventilation Installations

Ventilations Installations	
Type	Whole-Apartment Supply & Extract Ventilation
Model:	ComfortZone EX35
No. Wet Rooms:	2
Heat Recovery Efficiency:	N/A
Specific Fan Power:	0.26 w/l/s

Table 4.2.4: Ventilation Installations

4.2.5 Lighting Installations:

Lighting Installations	
Lamp Type:	LED
Luminaire Efficiency (lm/W)	Default (66.9)
Specific Power Density:	Default

Table 4.2.5: Lighting Installation

4.2.6 Renewable Technologies

Renewable Technologies	
Renewable Energy Ratio (% or BER)	326% or BER: 0.326

Table 4.2.6: Renewable technologies

4.2.7 Part L Compliance

The following image is the result taken from the DEAP software used to calculate the BER for each apartment.

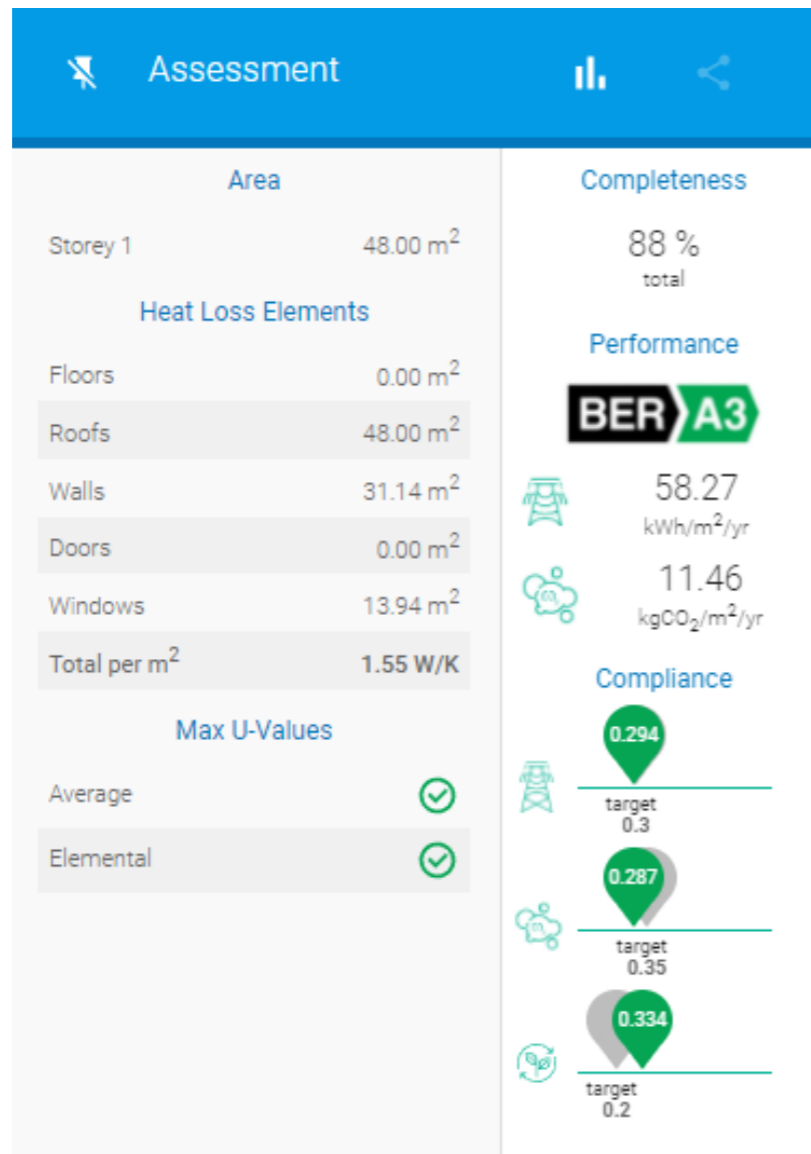


Figure 4.2.2: Part L Compliance – Primary Energy Breakdown

4.3 Block 2, Level 5 – 1 Bed Apartment Type A2 Mechanical & Electrical Installations

The following sub-sections detail the mechanical and electrical installation information used during the DEAP assessment for the below typical 1 Bed Apartment Type A2. This information comprises of the following:

- Primary heat generator
- Heating installations
- Hot water installations
- Ventilation installations
- Lighting installations

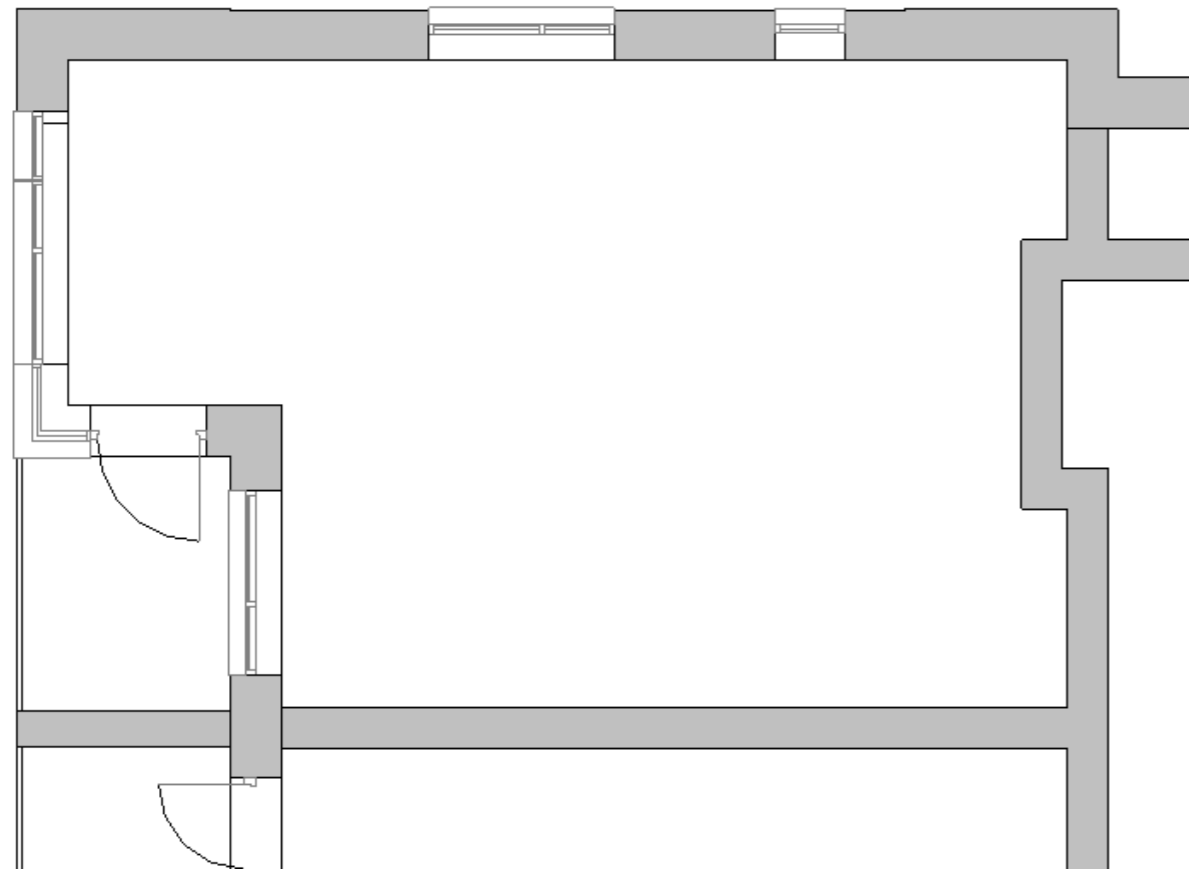


Figure 4.3.1: Typical 1-bed Type A2 Apartment

4.3.1 Primary Heat Generator

Primary Heat Generator	
Type	Exhaust Air Source Heat Pumps (De-Centralised)
Model:	ComfortZone EX35
Fuel:	Electricity
Heating (HTG) Flow Temperature:	45°C
Hot Water (HWS) Flow Temperature:	55°C
HTG Seasonal Energy Efficiency Ratio:	529.09%
HWS Seasonal Energy Efficiency Ratio:	251.86%

Table 4.3.1: Primary Heat Generator

4.3.2 Heating Installations

Heating Installations	
Type	Decentralised
Distribution:	Exhaust Air Heat Pumps
Heat Emitter:	Radiators

Table 4.3.2: Heating Installation

4.3.3 Hot Water Installations

Hot Water Installations	
Type	Exhaust Air Source Heat Pumps (De-Centralised)
Storage Type:	Exhaust Air Heat Pump Cylinder
Storage Volume:	170 Litres
Fitting Flow Rates	
- Shower	6 l/m
- Bath	N/A
- Sink	N/A
- Wash hand basin	N/A

Table 4.3.3: Hot Water Installations

4.3.4 Ventilation Installations

Ventilations Installations	
Type	Whole-Apartment Supply & Extract Ventilation
Model:	ComfortZone EX35
No. Wet Rooms:	2
Heat Recovery Efficiency:	N/A
Specific Fan Power:	0.26 w/l/s

Table 4.3.4: Ventilation Installations

4.3.5 Lighting Installations:

Lighting Installations	
Lamp Type:	LED
Luminaire Efficiency (lm/W)	Default (66.9)
Specific Power Density:	Default

Table 4.3.5: Lighting Installation

4.3.6 Renewable Technologies

Renewable Technologies	
Renewable Energy Ratio (% or RER)	334% or RER: 0.334

Table 4.3.6: Renewable technologies

4.3.7 Part L Compliance

The following image is the result taken from the DEAP software used to calculate the BER for each apartment.

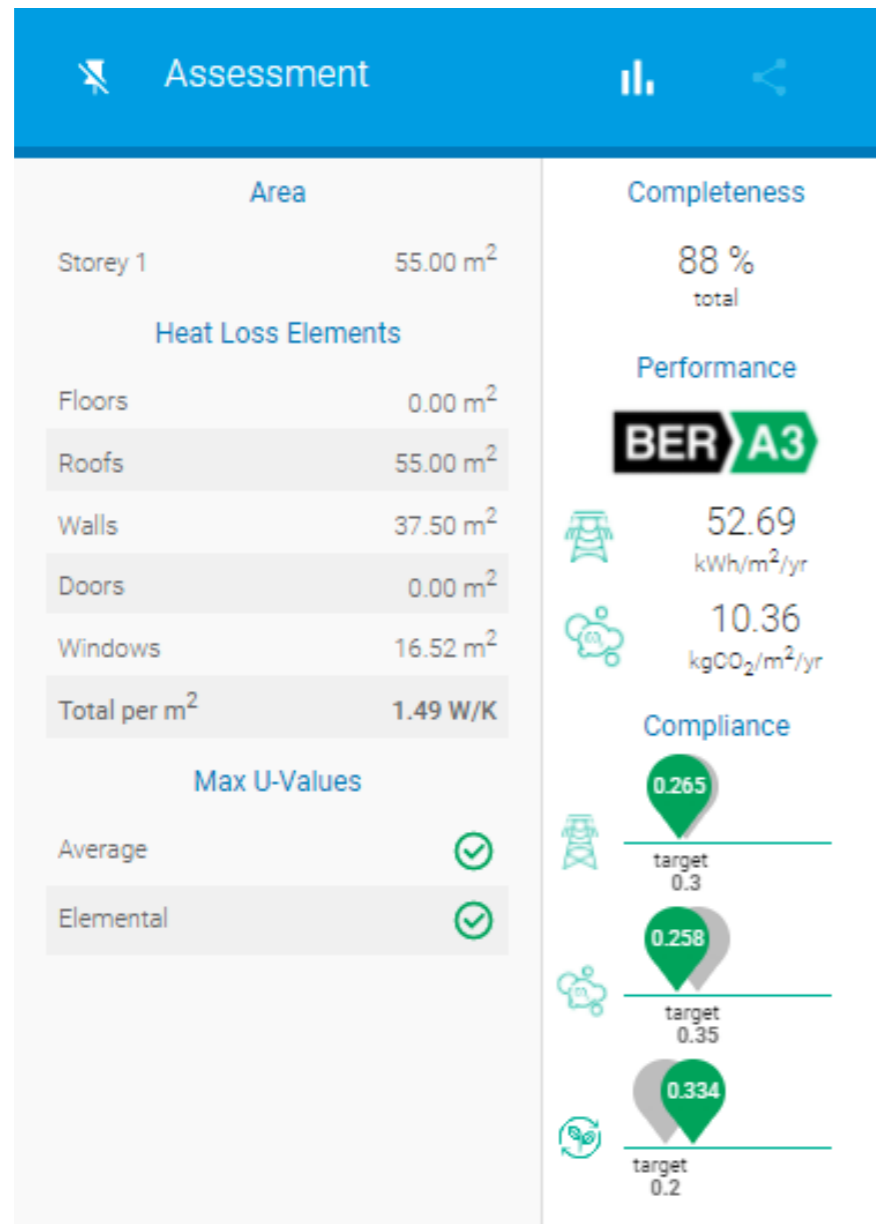


Figure 4.2.2: Part L Compliance – Primary Energy Breakdown

4.4 Block 1, Level 5 – 2 Bed Apartment Type B1 Mechanical & Electrical Installations

The following sub-sections detail the mechanical and electrical installation information used during the DEAP assessment for the below typical 2 Bed Apartment Type B1. This information comprises of the following:

- Primary heat generator
- Heating installations
- Hot water installations
- Ventilation installations
- Lighting installations

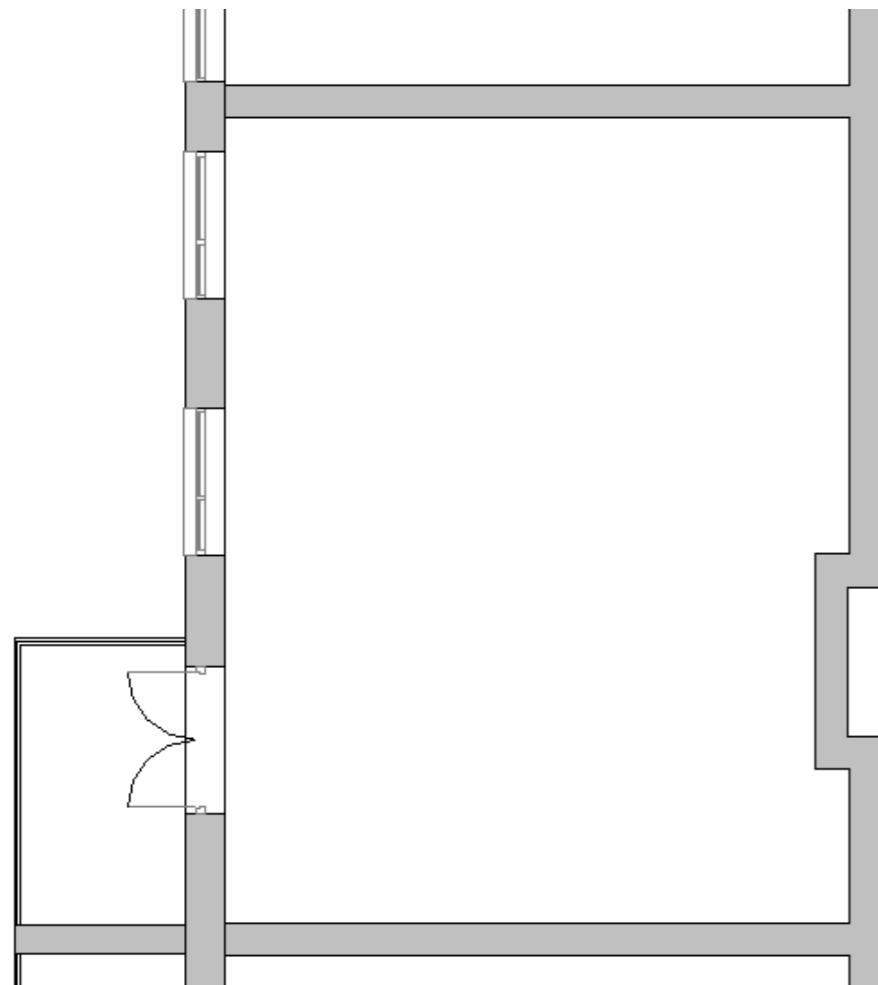


Figure 4.4.1: Typical 2 Bed Type B1 Apartment

4.4.1 Primary Heat Generator

Primary Heat Generator	
Type	Exhaust Air Source Heat Pumps (De-Centralised)
Model:	ComfortZone EX35
Fuel:	Electricity
Heating (HTG) Flow Temperature:	45°C
Hot Water (HWS) Flow Temperature:	55°C
HTG Seasonal Energy Efficiency Ratio:	523.23%
HWS Seasonal Energy Efficiency Ratio:	251.86%

Table 4.4.1: Primary Heat Generator

4.4.2 Heating Installations

Heating Installations	
Type	Decentralised
Distribution:	Exhaust Air Heat Pumps
Heat Emitter:	Radiators

Table 4.4.2: Heating Installation

4.4.3 Hot Water Installations

Hot Water Installations	
Type	Exhaust Air Source Heat Pumps (De-Centralised)
Storage Type:	Exhaust Air Heat Pump Cylinder
Storage Volume:	170 Litres
Fitting Flow Rates	
- Shower	6 l/m
- Bath	N/A
- Sink	N/A
- Wash hand basin	N/A

Table 4.4.3: Hot Water Installations

4.4.4 Ventilation Installations

Ventilations Installations	
Type	Whole-Apartment Supply & Extract Ventilation
Model:	ComfortZone EX35
No. Wet Rooms:	3
Heat Recovery Efficiency:	N/A
Specific Fan Power:	0.26 w/l/s

Table 4.3.4: Ventilation Installations

4.4.5 Lighting Installations:

Lighting Installations	
Lamp Type:	LED
Luminaire Efficiency (lm/W)	Default (66.9)
Specific Power Density:	Default

Table 4.3.5: Lighting Installation

4.4.6 Renewable Technologies

Renewable Technologies	
Renewable Energy Ratio (% or BER)	302% or BER: 0.302

Table 4.4.6: Renewable technologies

4.4.7 Part L Compliance

The following image is the result taken from the DEAP software used to calculate the BER for each apartment.

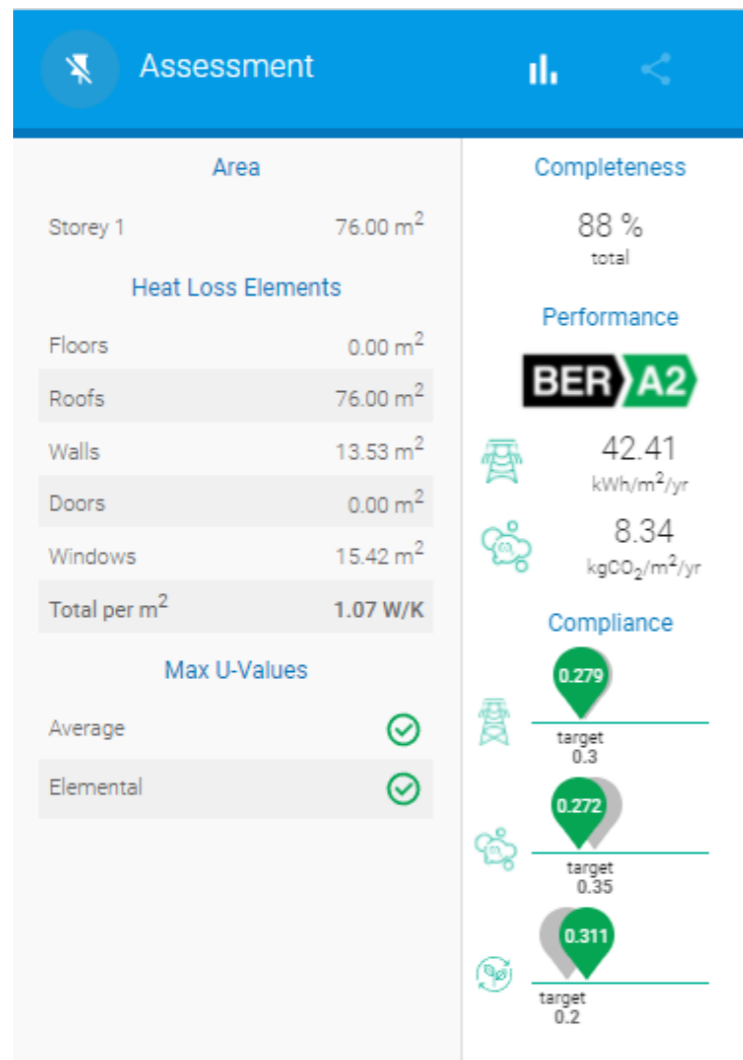


Figure 4.2.2: Part L Compliance – Primary Energy Breakdown

4.5 Block 1, Level 5 – 2 Bed Apartment Type B2 Mechanical & Electrical Installations

The following sub-sections detail the mechanical and electrical installation information used during the DEAP assessment for the below typical 2 Bed Apartment Type B2. This information comprises of the following:

- Primary heat generator
- Heating installations
- Hot water installations
- Ventilation installations
- Lighting installations

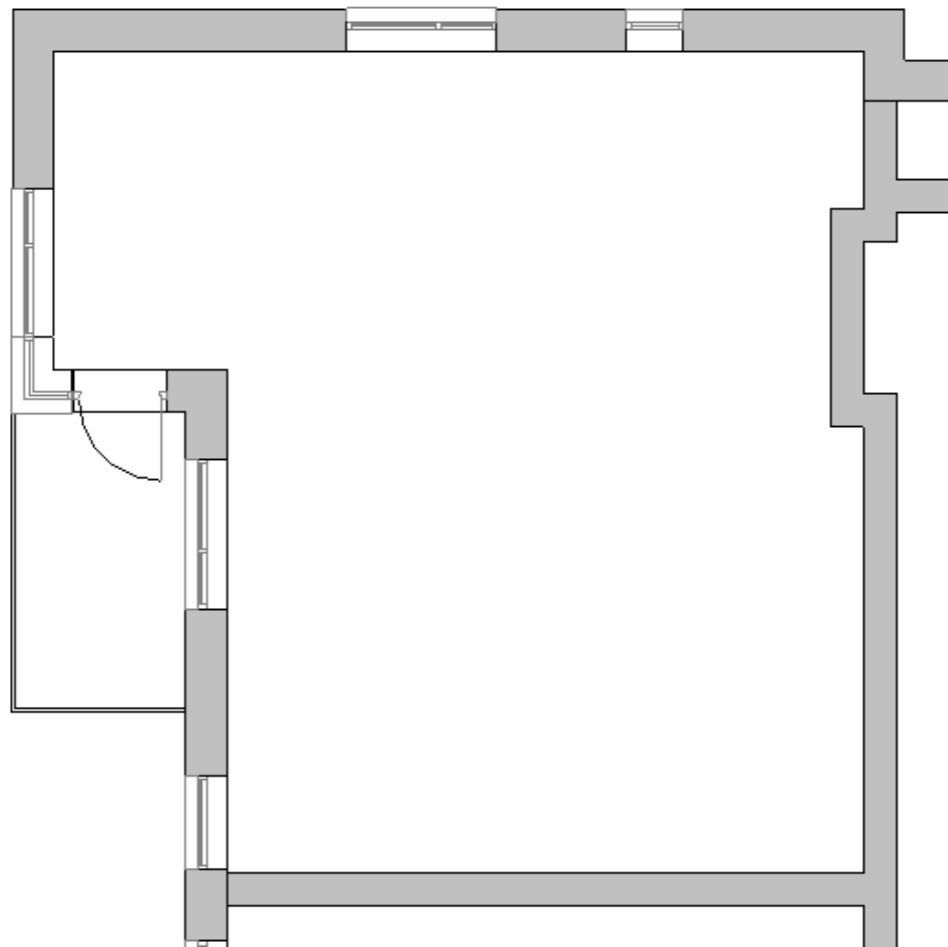


Figure 4.5.1: Typical 2 Bed Type B2 Apartment

4.5.1 Primary Heat Generator

Primary Heat Generator	
Type	Exhaust Air Source Heat Pumps (De-Centralised)
Model:	ComfortZone EX35
Fuel:	Electricity
Heating (HTG) Flow Temperature:	45°C
Hot Water (HWS) Flow Temperature:	55°C
HTG Seasonal Energy Efficiency Ratio:	518.19%
HWS Seasonal Energy Efficiency Ratio:	251.86%

Table 4.5.1: Primary Heat Generator

4.5.2 Heating Installations

Heating Installations	
Type	Decentralised
Distribution:	Exhaust Air Heat Pumps
Heat Emitter:	Radiators

Table 4.5.2: Heating Installation

4.5.3 Hot Water Installations

Hot Water Installations	
Type	Exhaust Air Source Heat Pumps (De-Centralised)
Storage Type:	Exhaust Air Heat Pump Cylinder
Storage Volume:	170 Litres
Fitting Flow Rates	
- Shower	6 l/m
- Bath	N/A
- Sink	N/A
- Wash hand basin	N/A

Table 4.5.3: Hot Water Installations

4.5.4 Ventilation Installations

Ventilations Installations	
Type	Whole-Apartment Supply & Extract Ventilation
Model:	ComfortZone EX35
No. Wet Rooms:	3
Heat Recovery Efficiency:	N/A
Specific Fan Power:	0.26 w/l/s

Table 4.5.4: Ventilation Installations

4.5.5 Lighting Installations:

Lighting Installations	
Lamp Type:	LED
Luminaire Efficiency (lm/W)	Default (66.9)
Specific Power Density:	Default

Table 4.5.5: Lighting Installation

4.5.6 Renewable Technologies

Renewable Technologies	
Renewable Energy Ratio (% or BER)	319% or BER: 0.319

Table 4.5.6: Renewable technologies

4.5.7 Part L Compliance

The following image is the result taken from the DEAP software used to calculate the BER for each apartment.

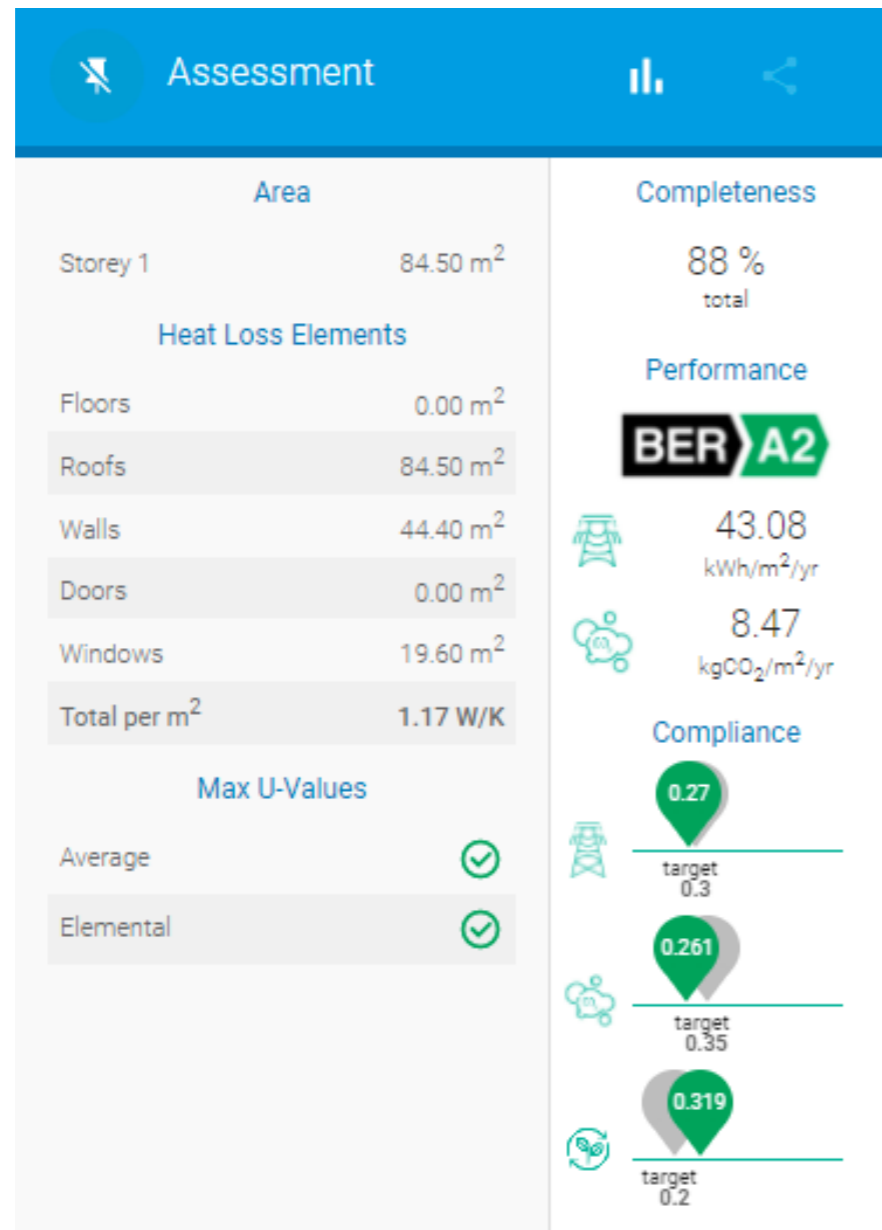


Figure 4.2.2: Part L Compliance – Primary Energy Breakdown

5.0 Development Average


As can be expected in large developments such as Carlisle Residential, every apartment may not meet the required criteria for NZEB. As stated previously, in developments like this with many dwellings, the results for all apartments may be averaged out to give an overall development score.

For the Carlisle Residential, one of the worst performing apartments of each apartment type (north facing, exposed roofs.. etc.) was taken and was used as the typical data for all apartments of that type in the development. In this case, all of the worst case apartments still individually met the criteria for NZEB. Below is the average score for the entire development using this data.

- Carlisle Residential Development

Average EPC	Average CPC	Average RER
0.2757	0.2679	0.3227

As can be seen from the above results, Carlisle Development passes all criteria to comply with NZEB.

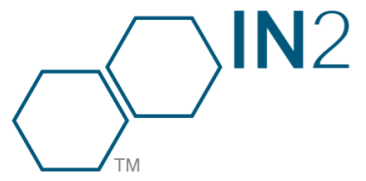

IN2 Engineering Design

Unit E&F

Mount Pleasant Business Park

Upper Mount Pleasant Avenue

Dublin 6

(01) 496 0900

info@in2.ie